


PLAN

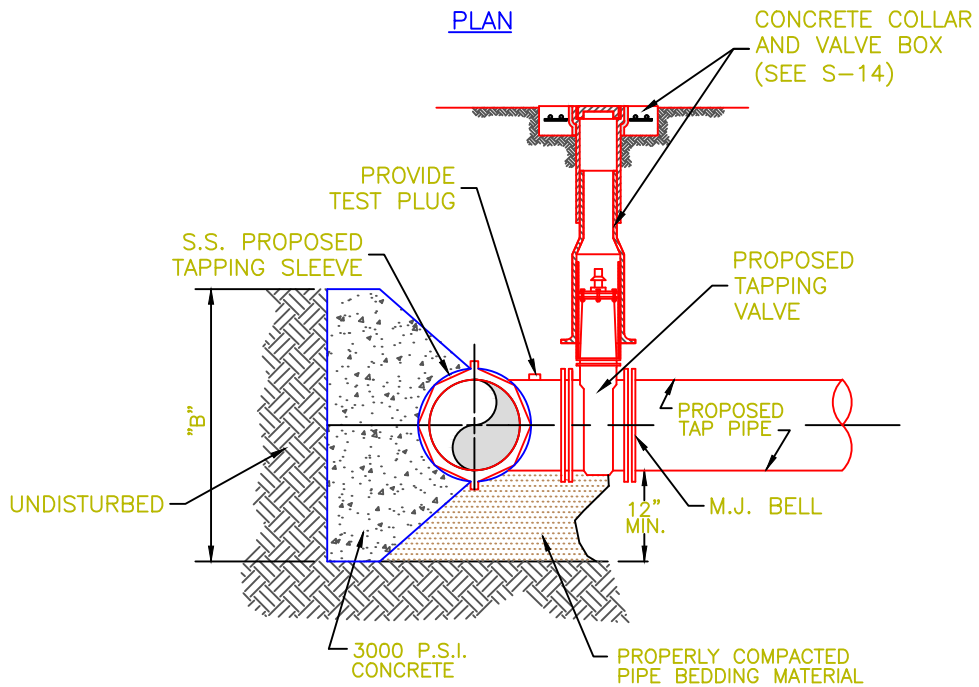

SECTION A-A

FOR DIMENSIONS "B" AND "d"  
SEE THRUST BLOCK DETAILS

NOTES:

- 1.) NO CUTS SHALL BE MADE BEFORE:
  - (A) A TEST OF 180 OR 200 P.S.I. FOR 60 MINUTES IS MADE.
  - (B) ALL FITTINGS TO BE WRAPPED WITH 20 MIL VISQUEEN AT THRUST BLOCK
  - (C) ALL TAPS TO BE MADE BY THE CONTRACTOR AND MATERIAL TO BE FURNISHED BY THE CONTRACTOR
- 2.) ALL TAPS MUST BE OF A SMALLER SIZE THAN THE MAIN BEING TAPPED & PLACED NO CLOSER THAN 30" OR A DISTANCE EQUAL TO (1) MAIN PIPE DIAMETER PLUS (2) TAP PIPE DIAMETERS (WHICHEVER IS LARGER) FROM A JOINT OR FITTING.

TAPPING SLEEVE & VALVE BLOCKING DETAIL

NOT TO SCALE

REV	DATE	BY	REVISIONS
1	20 JAN 11	REFJHS	REVISED VALVE COLLAR DETAIL NOTE



TECHNICAL  
STANDARDS  
MANUAL

TAPPING SLEEVE AND  
VALVE BLOCKING DETAIL  
TECHNICAL STANDARDS MANUAL  
CITY OF LYNN HAVEN FLORIDA

CAD FILE:	SEWER
DWN BY:	REF
DATE:	30 APR 07
SHEET NO:	11 OF 20
DETAIL	S-11