


NOTE:
PROVIDE IRRIGATION ONLY
IF RE-USE NOT REQUIRED

2" FORD BALL VALVE
CURB STOP B11-777
WITH VALVE BOX

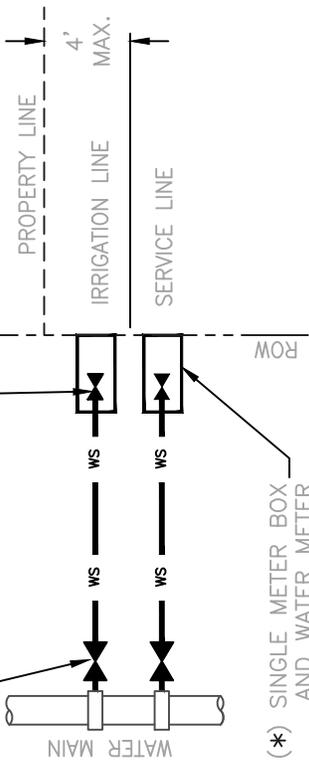


- NOTES:
1. ALL FITTINGS SHALL BE FORD BRASS WITH COMPRESSION/PACK JOINT TYPE CONNECTIONS.
 2. NO SERVICE LINE SHALL TERMINATE UNDER A DRIVEWAY.
 3. EACH SERVICE SHALL TERMINATE AT A BALL VALVE WHICH SHALL BE FASTENED TO A 1" x 4" x 30" STAKE PAINTED WHITE.
 4. CURB STOP SHALL BE A 2" FORD BALL METER VALVE B14-777 OR CITY APPROVED EQUAL.
 5. ALL SERVICE TAPS TO BE LOCATED IN FIELD. TAPS SHALL BE NO CLOSER THAN AND WILL NOT BE SET IN DRAINAGE SWALES, EASEMENTS OR SIDEWALKS.

TYPICAL CITY SERVICE

(*) METER AND METER BOXES
BY CITY FOR 2" LINES AND
SMALLER

(*) METER BOX
BY CONTRACTOR

25# BRONZE GATE VALVE
WITH RISING STEM
(SAME SIZE AS METER)

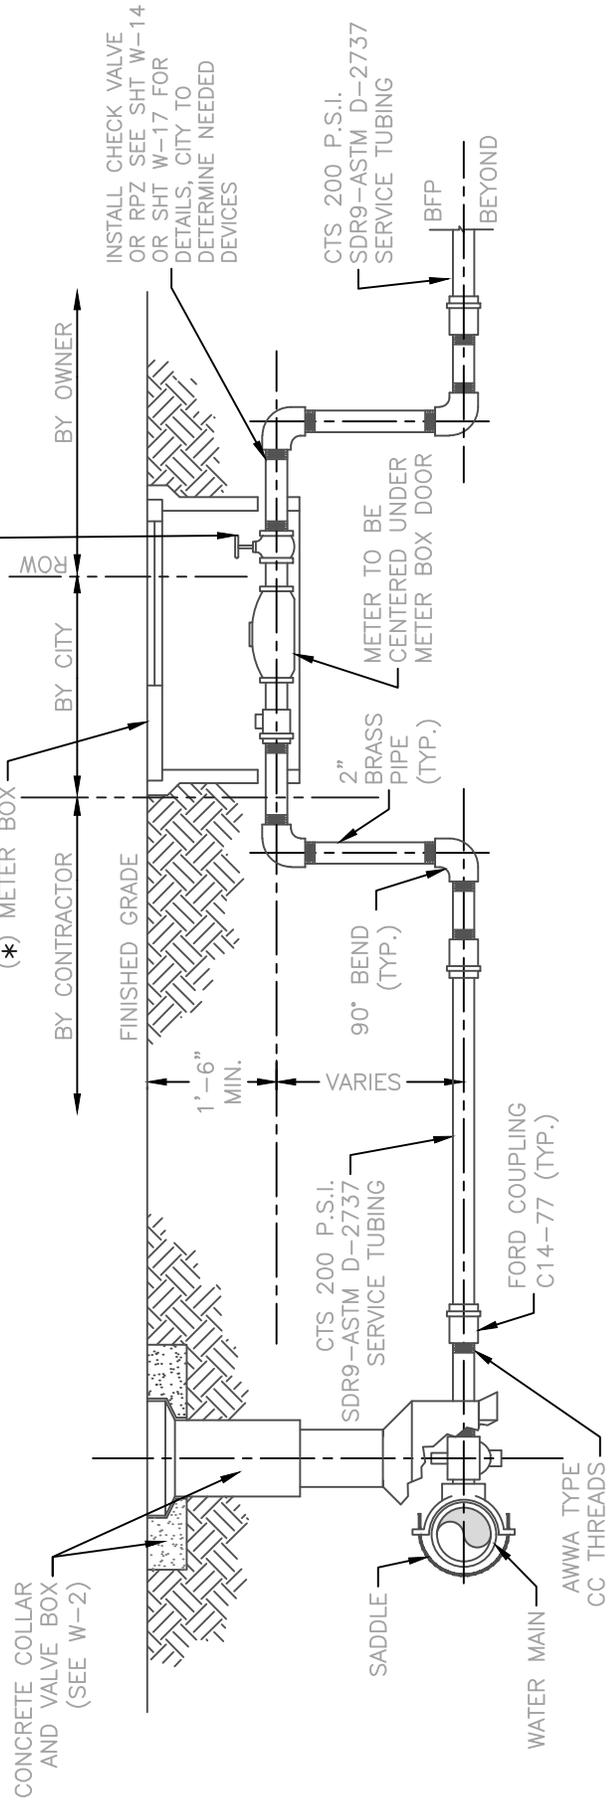

1-1/2" & 2" WATER METER INSTALLATION DETAILS
NOT TO SCALE

REV	DATE	BY	REVISIONS
2	17 JULY 05	RAL	ADDED CITY NOTE, MOVED ROW LINE
1	03 JUN 11	REFJHJS	REVISED DETAIL ADDED NOTES



**TECHNICAL
STANDARDS
MANUAL**

**1-1/2" & 2" WATER METER
INSTALLATION DETAILS**
TECHNICAL STANDARDS MANUAL
CITY OF LYNN HAVEN FLORIDA

CAD FILE:	WATER
DWN BY:	REF
DATE:	30 APR 07
SHEET NO:	15 OF 27
DETAIL	W-15