


PLAN VIEW

- NOTE:
- METER WILL BE PROVIDED AND INSTALLED BY CONTRACTOR.
 - ALL ABOVE GROUND PIPE AND FITTINGS SHALL BE FLANGED DUCTILE IRON.
 - ALL ITEMS ABOVE GRADE SHALL HAVE TWO COATS OF APPROVED EPOXY BLUE ENAMEL PAINT.
 - ALL VALVES SHALL HAVE HANDWHEELS.
 - VALVE(S) SHALL BE CHAINED AND PADLOCKED IN OPENED POSITION.
 - BACKFLOW DEVICE SHALL BE RPZ OR DC TYPE AS APPROVED BY CITY.
 - REDUCER AS REQUIRED IF METER SIZE DIFFERS FROM PIPE SIZE.

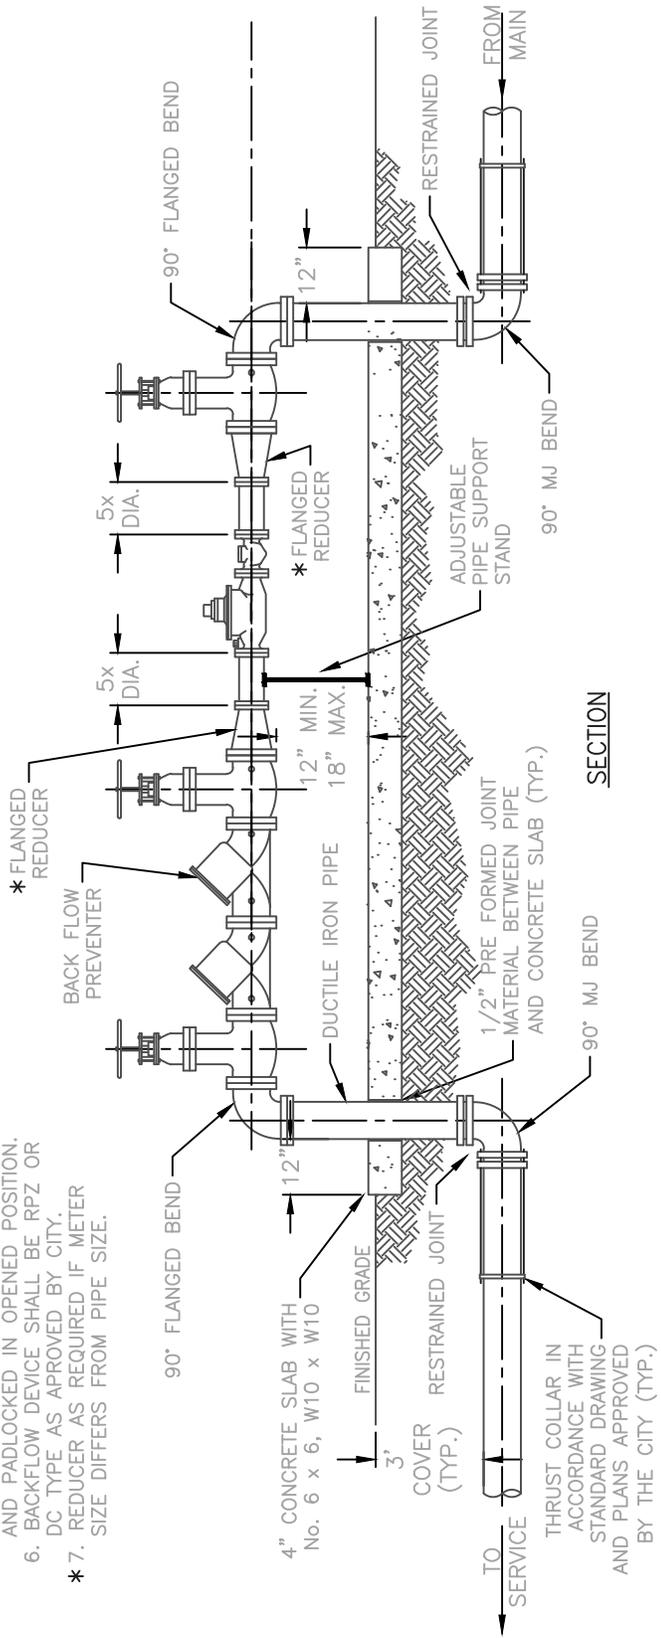

SECTION

WATER METER & BACKFLOW INSTALLATION DETAIL

NOT TO SCALE

REV	DATE	BY	REVISIONS



TECHNICAL STANDARDS MANUAL

WATER METER & BACKFLOW INSTALLATION DETAIL
TECHNICAL STANDARDS MANUAL
 CITY OF LYNN HAVEN FLORIDA

CAD FILE:	WATER
DWN BY:	REF
DATE:	30 APR 07
SHEET NO:	17 OF 27
DETAIL	W-17